


105U-3, 105S-3

Installation Guide

Statutory Requirements

EC: Unlicensed operation limits the radio power. High gain aerials may only be used to compensate for cable losses.

Aerial Installation

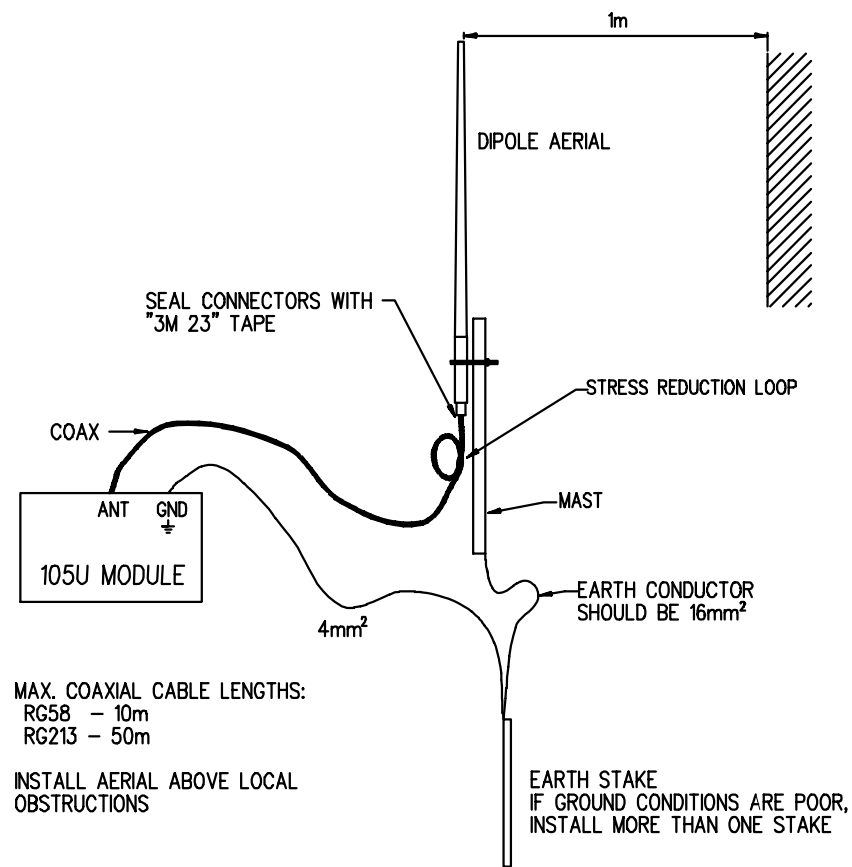

105-3 I/O Installation

- Power supply may be:
- (A) 12-24VAC
 - (B) 15-30VDC
 - (C) Supply battery or 11-15 VDC
 - (D) Solar panel with solar battery

Choose option and wire as shown

